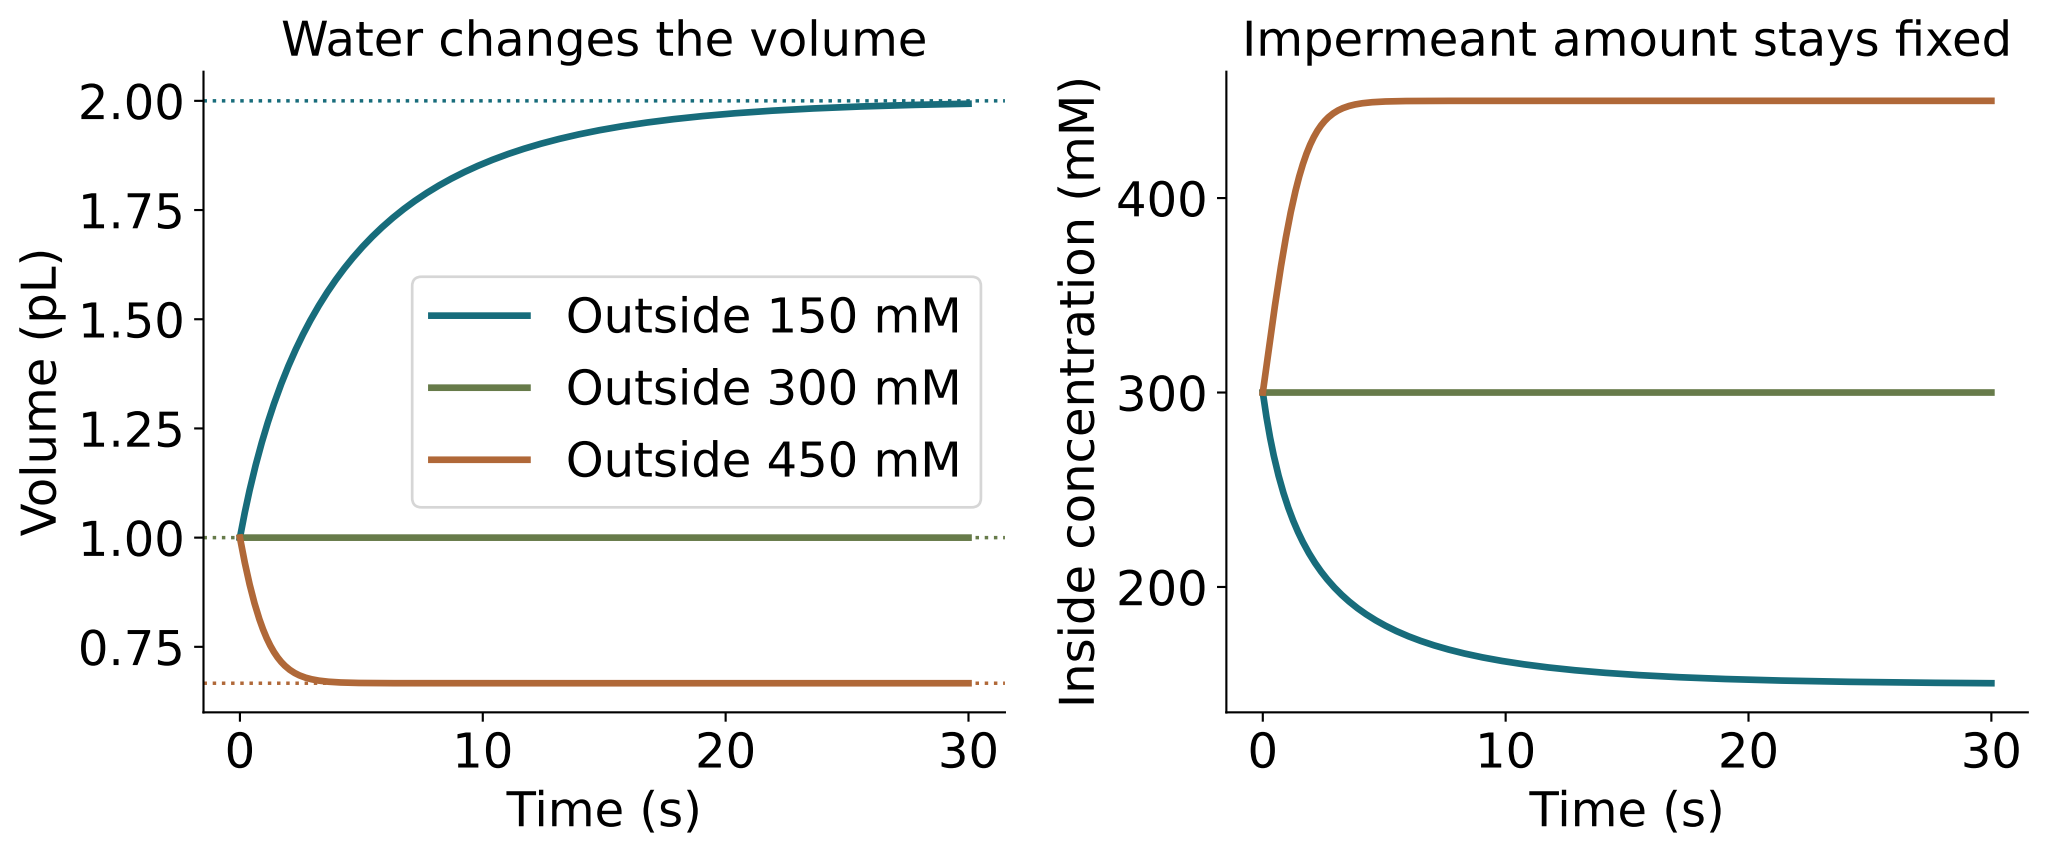

Water changes the volume
Volume (pL)
2.00
1.75
1.50
1.25
1.00
0.75
0
10
20
30
Time (s)
Outside 150 mM
Outside 300 mM
Outside 450 mM
Impermeant amount stays fixed
Inside concentration (mM)
400
300
200
0
10
20
30
Time (s)